

試驗報告



報告編號：TK-26-00870

頁數：1 OF 3

報告發行日期：115年03月14日

喬城實業有限公司

產品名稱：200型玻璃爪具(#304)

送驗廠商：喬城實業有限公司

收件日期：115年02月26日

試驗日期：115年02月26日~115年03月12日

備註：1.以上資料(會驗廠商、試驗方法、試驗數量、收件日期及試驗日期除外)及

下述報告內容標示#處係由顧客提供

2.除非另有說明，此報告結果僅適用於收取之試驗件

未經本公司事先書面同意，此報告不可部分複製

本實驗室依據顧客所提供之試驗需求與樣品進行試驗，結果說明如下：

試驗需求：1.抗壓試驗

2.抗拉試驗

3.成分分析

試驗方法：1.依顧客指定方式如相片所示,均勻施加荷重抗壓至1000kgf為止(試驗速率：10mm/min)，並記錄在200、400、600、800、1000kgf荷重下之對應變形量。

2.依顧客指定方式如相片所示,均勻施加荷重抗拉至破壞為止(試驗速率：10mm/min)

3. CNS 10006:2024

試驗結果：

1.抗壓試驗

#試件名稱	客戶指定抗壓荷重	對應變形量	試驗結果
	kgf	mm	
200型玻璃爪具(#304)	202	0.44	爪具變形
	401	0.79	爪具變形
	605	1.21	爪具變形
	800	2.14	爪具變形
	1000	5.30	爪具變形

2.抗拉試驗

#試件名稱	最大抗拉荷重	破壞情形
	kgf	
駁接頭	634	如照片所示

3.成分分析

#試件名稱	C	Si	S	P	Mn	Ni	Cr
	%	%	%	%	%	%	%
200型玻璃爪具(#304)	0.14	0.49	0.017	0.042	1.01	7.99	17.42

備註：1.本實驗室執行試驗之地點同實驗室地址。

2.樣品描述：金屬件。

----- 1 -----

本報告若有提供規範值，該規範值僅供參考，合格之判定以委託單位實際要求為準

報告簽署人

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com.tw/terms-of-service> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <https://www.sgs.com.tw/terms-of-service>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

試驗報告




報告編號 : TK-26-00870
 頁數 : 2 OF 3
 報告發行日期 : 115 年 03 月 14 日



試驗照片
 #200 型玻璃爪具(#304)

試驗後樣品
 #200 型玻璃爪具(#304)

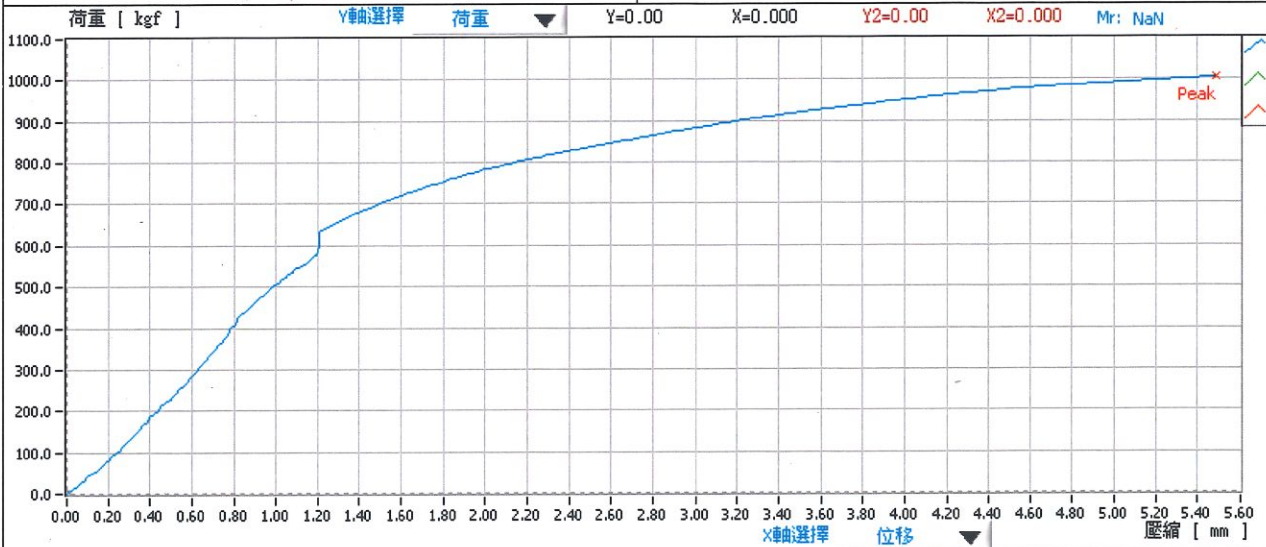

荷重-位移曲線圖
 #200 型玻璃爪具(#304)

----- 2 -----

本報告若有提供規範值, 該規範值僅供參考, 合格之判定以委託單位實際要求為準

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com.tw/terms-of-service> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <https://www.sgs.com.tw/terms-of-service>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

試驗報告



報告編號 : TK-26-00870

頁數 : 3 OF 3

報告發行日期 : 115 年 03 月 14 日



樣品照片



試驗照片



試驗照片



試驗後樣品

----- oOo -----

本報告若有提供規範值, 該規範值僅供參考, 合格之判定以委託單位實際要求為準

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com.tw/terms-of-service> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <https://www.sgs.com.tw/terms-of-service>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

TWE 5386577

試驗報告

報告編號：TK-12-00003X
 頁數：1 OF 2
 報告日期：101年01月11日



喬城實業有限公司

我們根據客戶送交之樣品逐一進行測試，結果如下：

產品名稱： 200型玻璃爪具(#316)
送樣日期： 101年01月02日
試驗日期： 101年01月02日~101年01月10日
測試要求： 抗壓試驗、抗拉試驗、成份分析
測試方法： 依客戶指定方式如相片所示，均勻施加荷重執行抗壓、抗拉測試(測試速率：10mm/min)、CNS 10006(1984)

測試結果：

抗壓試驗

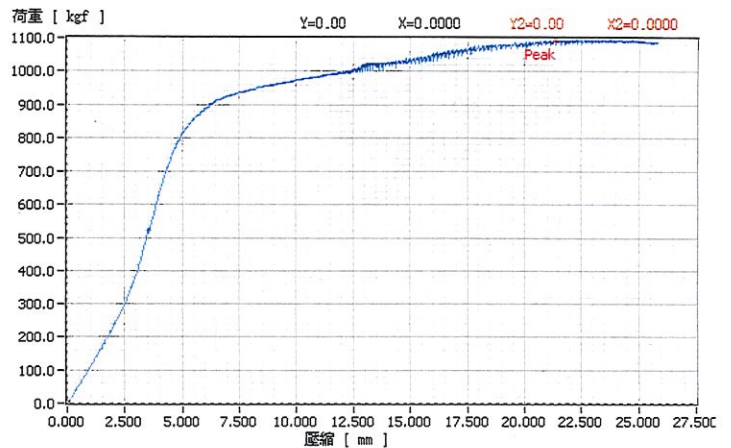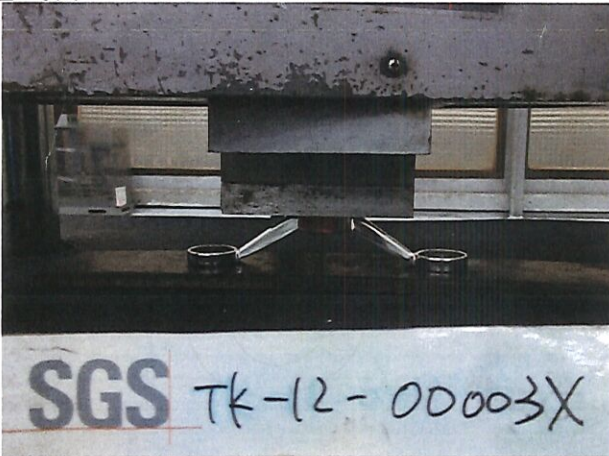

試件名稱	顧客指定抗壓荷重	對應變形量	破壞情形
----	kgf	mm	----
爪具	205	1.8	爪具變形
	398	3.0	爪具變形
	607	3.9	爪具變形
	798	4.9	爪具變形
	1000	12.8	爪具變形

----- 1 -----

(Handwritten signature)
 報告簽署人

本報告若有提供規範值時，該規範值僅供參考，合格之判定以委託單位實際要求為準。

Unless otherwise stated the results shown in this test report refer only to the sample(s) tested. This test report cannot be reproduced, except in full, without prior written permission of the Company. 除非另有說明，此報告結果僅對測試之樣品負責。本報告未經本公司書面許可，不可部份複製。

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

TWA 6417479

試驗報告

報告編號：TK-12-00003X
 頁數：2 OF 2
 報告日期：101年01月11日

測試結果：
 抗拉試驗



試件名稱	最大抗拉荷重	破壞情形
----	kgf	----
駁接頭	1800	轉動軸心無法旋轉

成份分析

試件名稱	C	Si	S	P	Mn	Ni	Cr	Mo
----	%	%	%	%	%	%	%	%
爪具	0.03	1.12	0.004	0.035	0.96	10.04	16.92	2.01

-----oOo-----

本報告若有提供規範值時，該規範值僅供參考，合格之判定以委託單位實際要求為準。

(Handwritten Signature)
 報告簽署人

Unless otherwise stated the results shown in this test report refer only to the sample(s) tested. This test report cannot be reproduced, except in full, without prior written permission of the Company. 除非另有說明，此報告結果僅對測試之樣品負責。本報告未經本公司書面許可，不可部份複製。

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

TWA 6417478

Laboratory Testing · ISO Certification · Inspection
No. 9, 14th Rd., Taichung Industrial Park,
Taichung 40755, Taiwan, R.O.C.
Tel : (04) 23591515 (代表號)
Fax : (04) 23592557

REPORT NO: **PAGE NO 1**
TK-12-00003X



材料暨工程實驗室-台中

試驗報告



報告編號:TK-18-02590

頁次:1 OF 1

報告日期:107年05月18日

工程名稱: 中臺灣影視基地新建工程-採光罩
 承包商: 聖典有限公司
 委託單位: 聖典有限公司
 樣品名稱: 不銹鋼玻璃爪具
 送驗人員: 聖典有限公司-王清男
 收件日期: 107年05月16日
 試驗日期: 107年05月16日~107年05月18日
 試驗方法: CNS 10006(1984)
 備註: 1.以上資料由顧客提供(收件及試驗日期除外)
 2.除非另有說明,此報告結果僅對測試之樣品負責
 未經本公司事先書面同意,此報告不可部分複製

試驗結果:

成份分析

試件名稱	C	Si	S	P	Mn	Ni	Cr
----	%	%	%	%	%	%	%
不銹鋼玻璃爪具	0.06	0.55	0.006	0.025	0.61	8.17	17.07

----- oOo -----

本報告若有提供規範值時,該規範值僅供參考,合格之判定以委託單位實際要求為準。


 報告簽署人

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.